


Outline Drawing

Type with cover

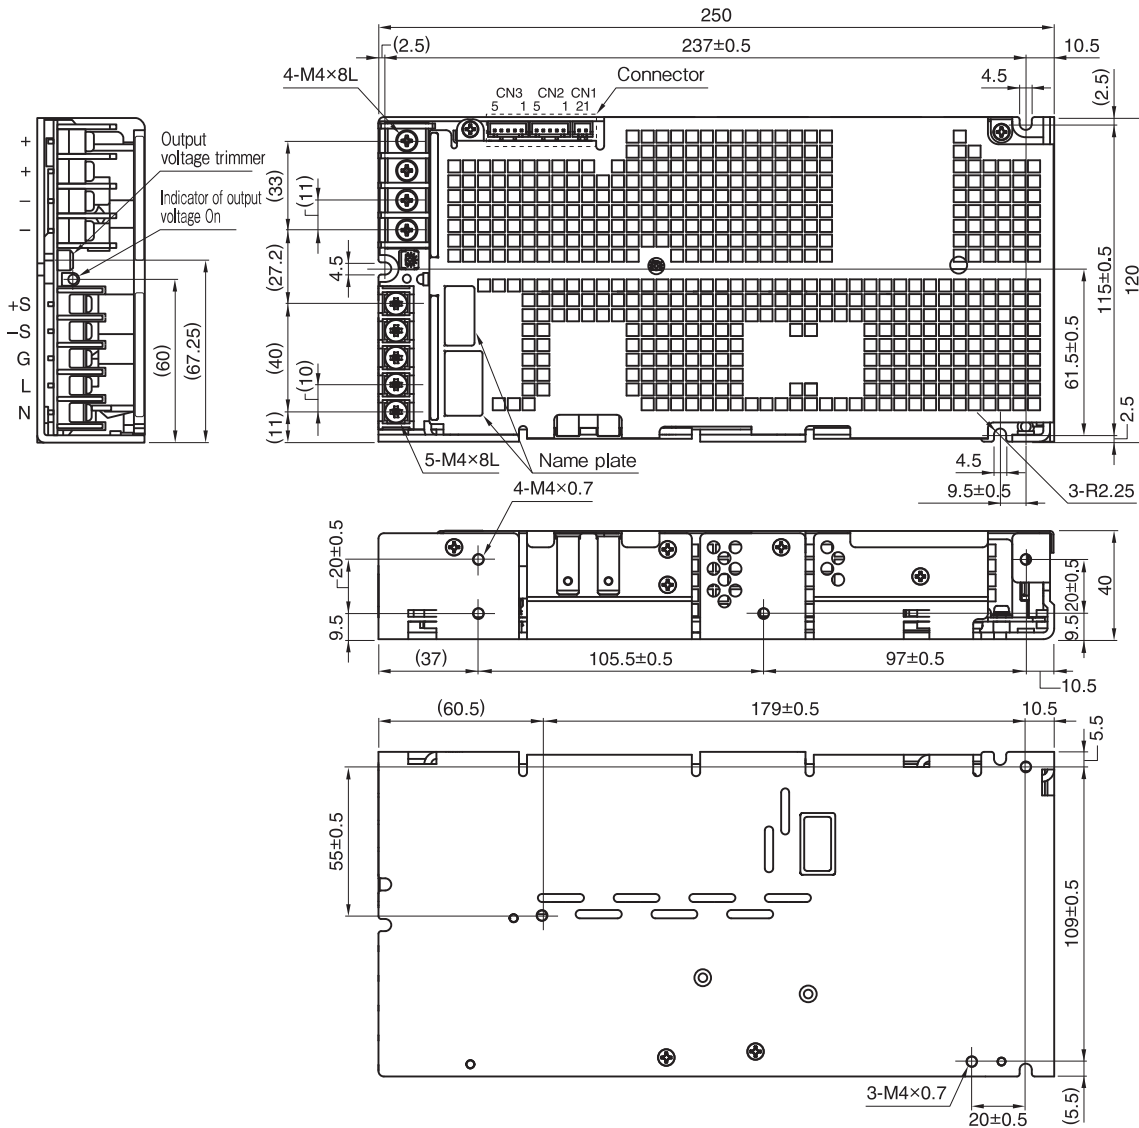


Unit: mm

* The insertion length of screws used for mounting the power supply should be within 6mm from the product surface. Allowable tolerance is ± 1 mm if not specified separately.

Terminals

Type with cover/Type L

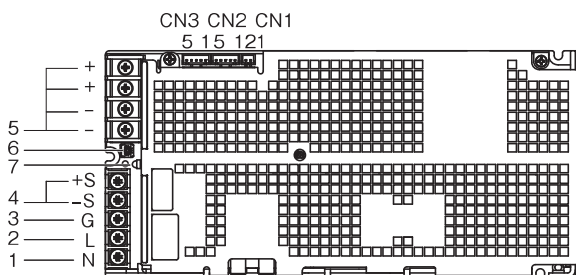

| CN1 | CN2 | CN3 |
|-------|-------|-------|
| 1 -PF | 1 -RC | 1 -RC |
| 2 +PF | 2 +RC | 2 +RC |
| | 3 CB | 3 CB |
| | 4 RV | 4 RV |
| | 5 -S | 5 -S |

| Terminal No. | Name and function |
|--------------|--------------------------------------|
| 1 | AC input terminal (N) |
| 2 | AC input terminal (L) |
| 3 | Ground terminal (G) |
| 4 | Remote sensing terminal (+S, -S) |
| 5 | DC output terminal (+, -) |
| 6 | Output voltage trimmer (V_{ADJ}) |
| 7 | LED output indicator (green) |